

EJE 3 M404  
PK 0+000 - 0+479.388


PK= 0+143.213  
CV= 776.716  
KV= 4913.000  
W = -0.018  
Lv= 90.008  
D = 0.206

PK= 0+318.446  
CV= 774.382  
KV= 5740.000  
W = -0.016  
Lv= 90.001  
D = 0.176

PK= 0+431.904  
CV= 771.092  
KV= 4286.000  
W = 0.021  
Lv= 90.006  
D = -0.236

LEYENDA

RASANTE  
TERRENO

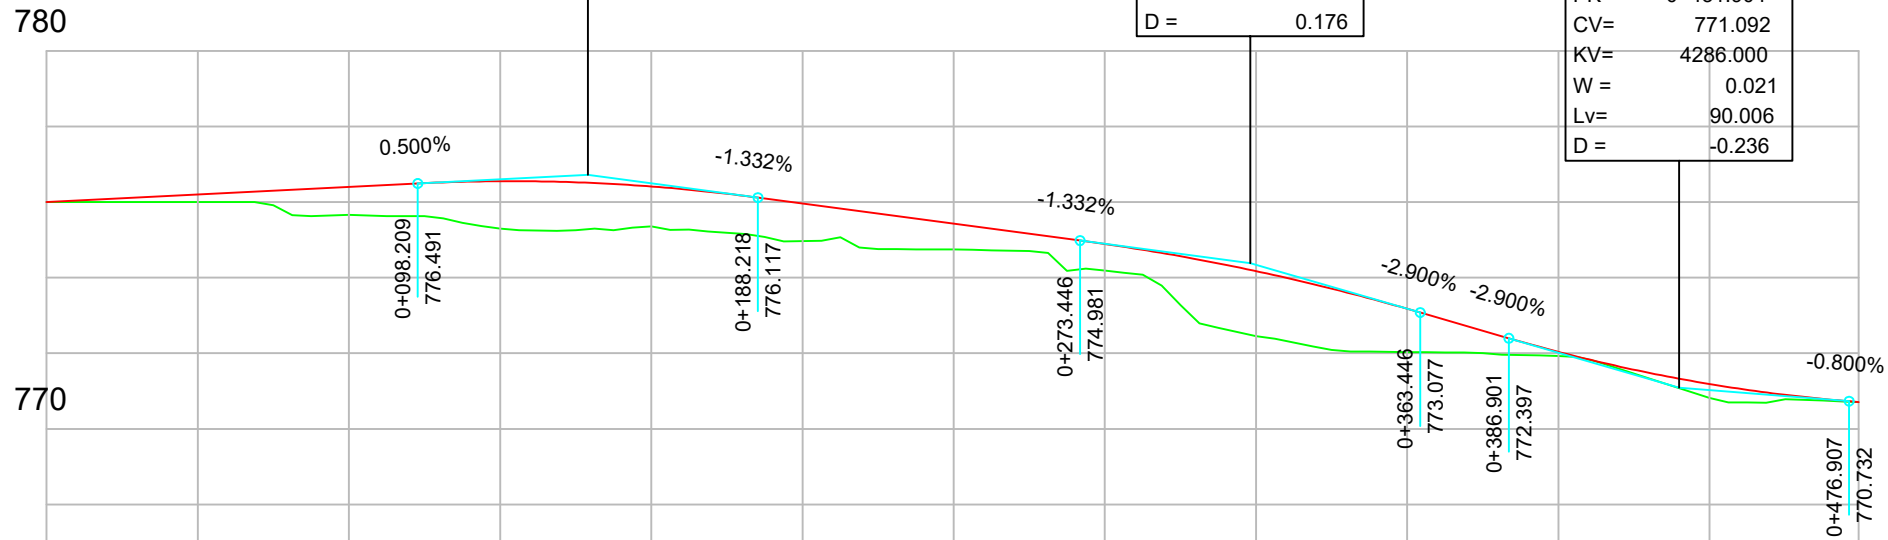

P.K.		
COTAS		
	RASANTE	TERRENO
0+000	776.000	776.00
0+100	776.200	776.00
	776.400	775.66
	776.552	775.29
0+200	776.411	775.36
	775.960	774.97
	775.427	774.74
0+300	774.890	774.18
	774.172	772.45
	773.176	772.03
0+400	772.037	771.93
	771.186	770.82
0+479.388	770.712	770.71

DIAGRAMA  
DE  
CURVATURAS

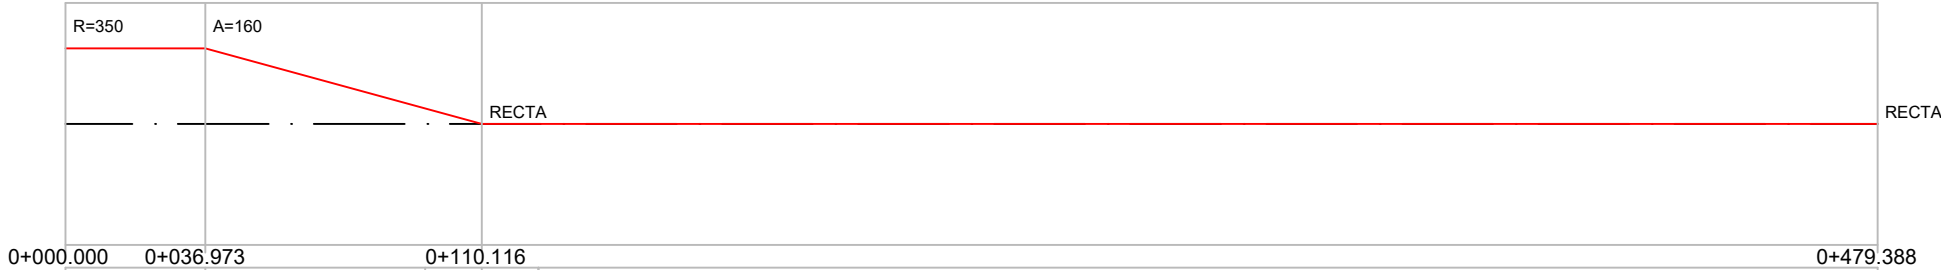


DIAGRAMA  
DE  
PERALTES

