

EJE 22 CAMINO DE SERVICIO  
MARGEN IZQUIERDA 2  
PK 0+600 - 1+200

PK= 0+655.046  
CV= 777.559  
KV= 1920.000  
W = -0.021  
Lv= 40.005  
D = 0.104

PK= 0+703.783  
CV= 776.104  
KV= 940.000  
W = 0.043  
Lv= 40.005  
D = -0.213


PK= 0+774.486  
CV= 777.001  
KV= 812.000  
W = -0.049  
Lv= 40.019  
D = 0.247

PK= 0+931.675  
CV= 771.250  
KV= 1650.000  
W = 0.027  
Lv= 43.871  
D = -0.146

PK= 1+025.333  
CV= 770.313  
KV= 1650.000  
W = 0.048  
Lv= 78.871  
D = -0.471

PK= 1+149.682  
CV= 775.014  
KV= 1000.000  
W = -0.047  
Lv= 46.880  
D = 0.275

LEYENDA  
— RASANTE  
— TERRENO

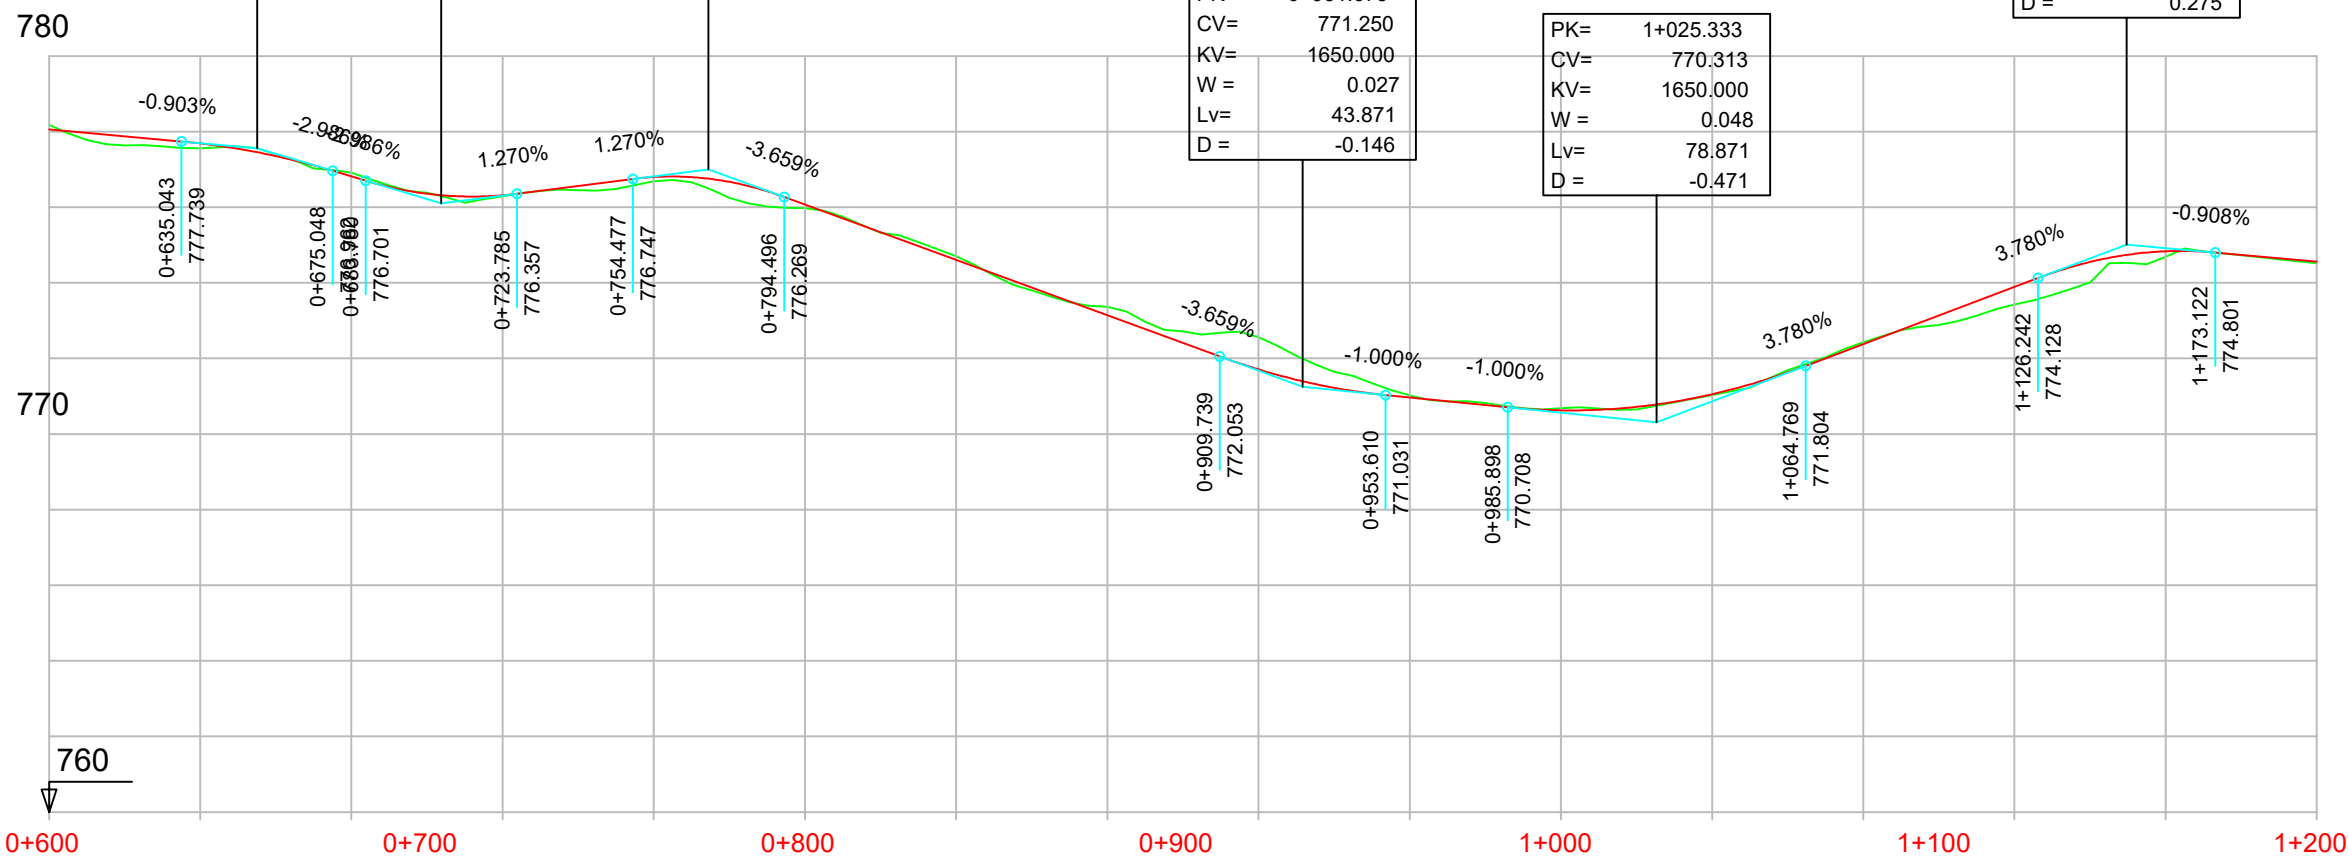

P.K.		
COTAS	RASANTE	TERRENO

P.K.		
COTAS	RASANTE	TERRENO
0+600	778.056	778.18
0+655.046	777.688	777.56
0+703.783	776.814	776.92
0+723.785	776.317	776.29
0+754.477	776.798	776.69
0+794.496	776.068	775.97
0+800	774.604	774.70
0+850	773.141	773.37
0+909.739	771.709	772.56
0+931.675	770.967	771.02
0+985.898	770.627	770.68
1+000	771.054	771.03
1+025.333	772.380	772.43
1+064.769	773.892	773.43
1+100	774.834	774.69
1+149.682	774.557	774.52
1+200		

DIAGRAMA  
DE  
CURVATURAS

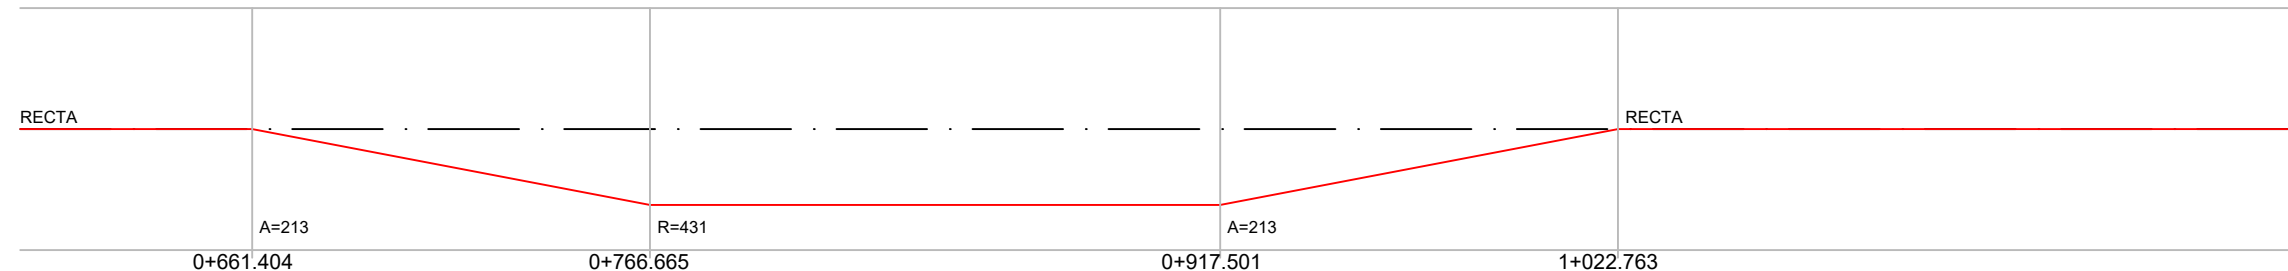


DIAGRAMA  
DE  
PERALTES

