

EJE 22 CAMINO DE SERVICIO
MARGEN IZQUIERDA 2
PK 0+600 - 1+200

PK= 0+655.046
CV= 777.559
KV= 1920.000
W = -0.021
Lv= 40.005
D = 0.104

PK= 0+703.783
CV= 776.104
KV= 940.000
W = 0.043
Lv= 40.005
D = -0.213


PK= 0+774.486
CV= 777.001
KV= 812.000
W = -0.049
Lv= 40.019
D = 0.247

PK= 0+931.675
CV= 771.250
KV= 1650.000
W = 0.027
Lv= 43.871
D = -0.146

PK= 1+025.333
CV= 770.313
KV= 1650.000
W = 0.048
Lv= 78.871
D = -0.471

PK= 1+149.682
CV= 775.014
KV= 1000.000
W = -0.047
Lv= 46.880
D = 0.275

LEYENDA
RASANTE
TERRENO

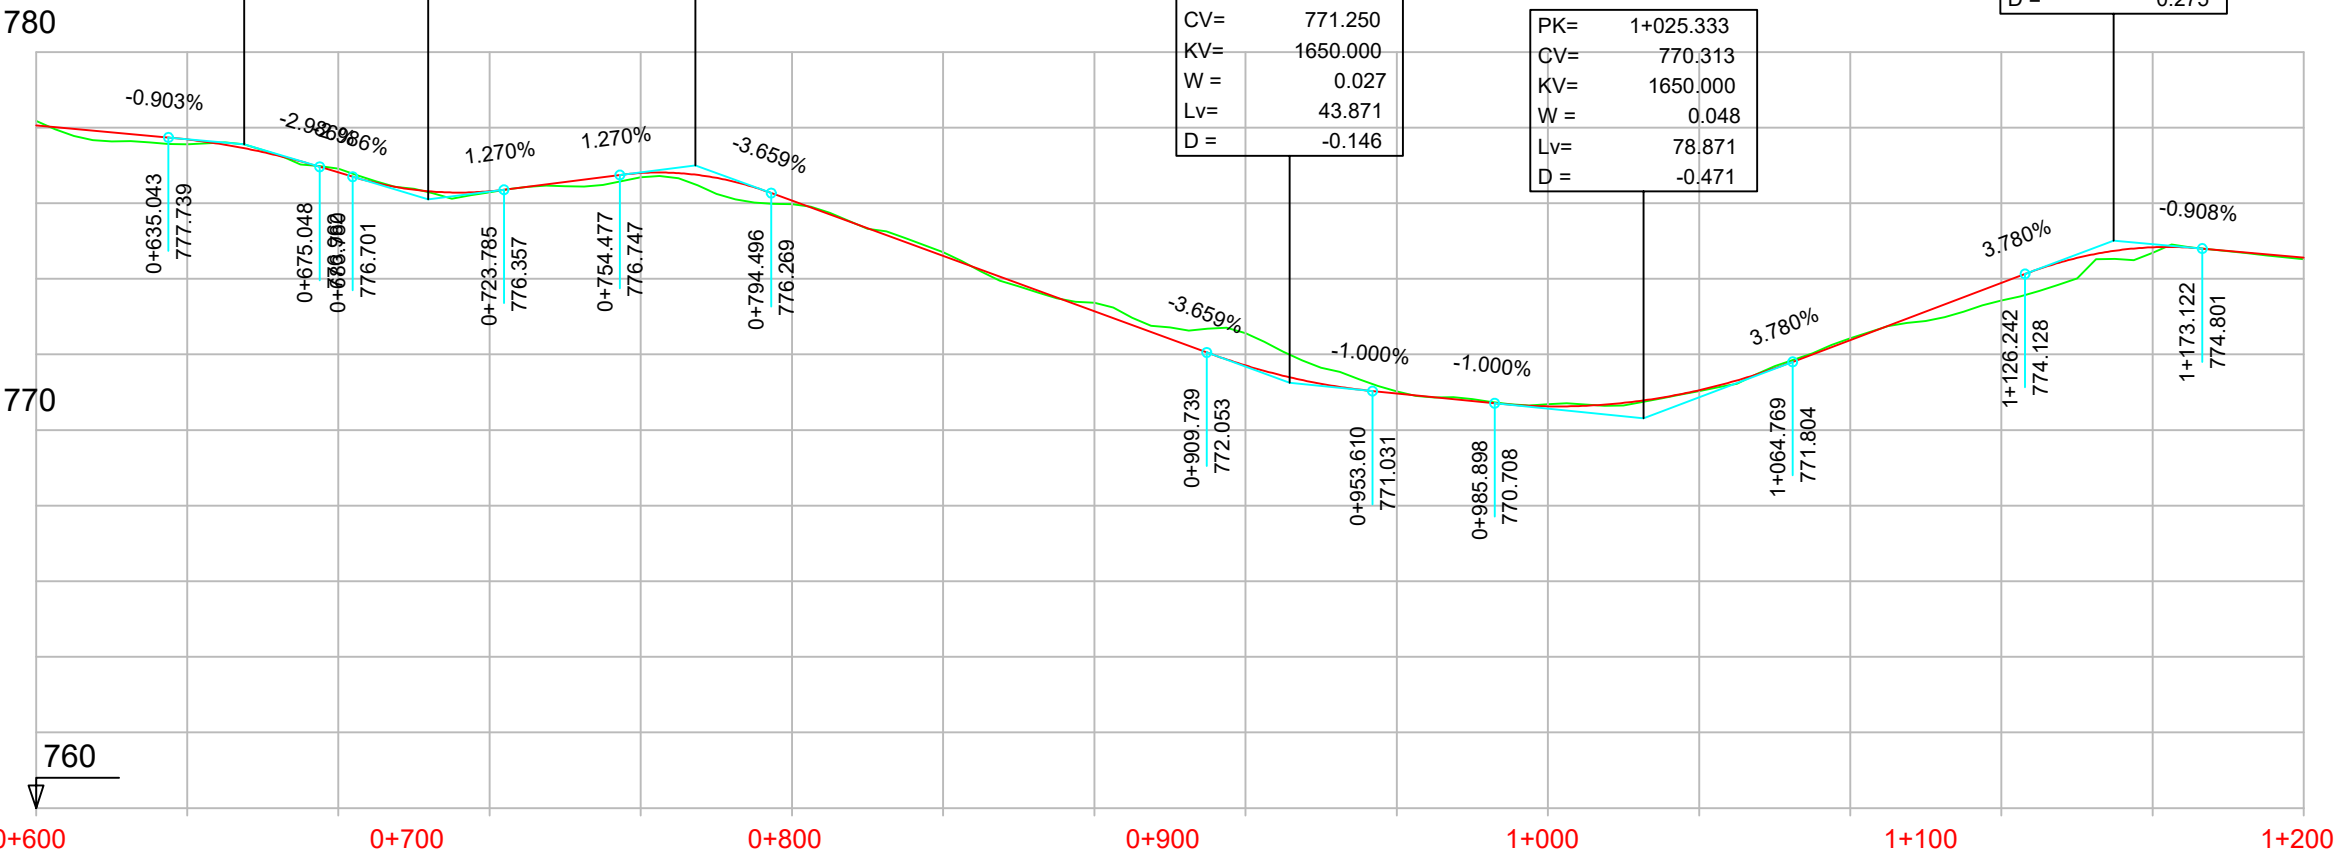

P.K.		
COTAS	RASANTE	TERRENO

0+600	0+700	0+800	0+900	1+000	1+100	1+200
778.056 778.18	777.688 777.56	776.814 776.92	776.317 776.29	776.798 776.69	776.068 775.97	774.604 774.70
773.141 773.37	771.709 772.56	770.967 771.02	770.627 770.68	771.054 771.03	772.380 772.43	773.892 773.43
774.834 774.69	774.557 774.52					

DIAGRAMA
DE
CURVATURAS

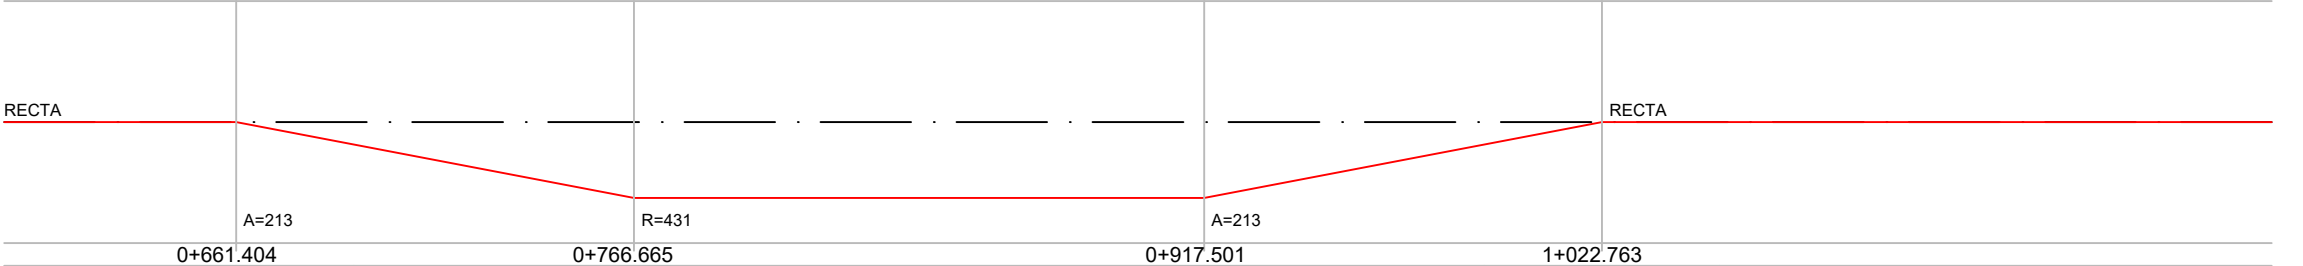


DIAGRAMA
DE
PERALTES

