

EJE 22 CAMINO DE SERVICIO  
MARGEN IZQUIERDA 2  
PK 1+200 - 1+800

PK=	1+760.672
CV=	778.547
KV=	1540.000
W =	-0.030
Lv=	46.200
D =	0.173


PK=	1+646.776
CV=	776.269
KV=	2667.000
W =	0.015
Lv=	40.005
D =	-0.075

PK=	1+465.098
CV=	775.361
KV=	2000.000
W =	-0.018
Lv=	36.379
D =	0.083

PK=	1+325.998
CV=	772.135
KV=	760.000
W =	0.054
Lv=	41.109
D =	-0.278

PK=	1+267.447
CV=	773.945
KV=	1500.000
W =	-0.022
Lv=	32.732
D =	0.089

LEYENDA		
<span style="color: red;">—</span>	RASANTE	
<span style="color: green;">—</span>	TERRENO	

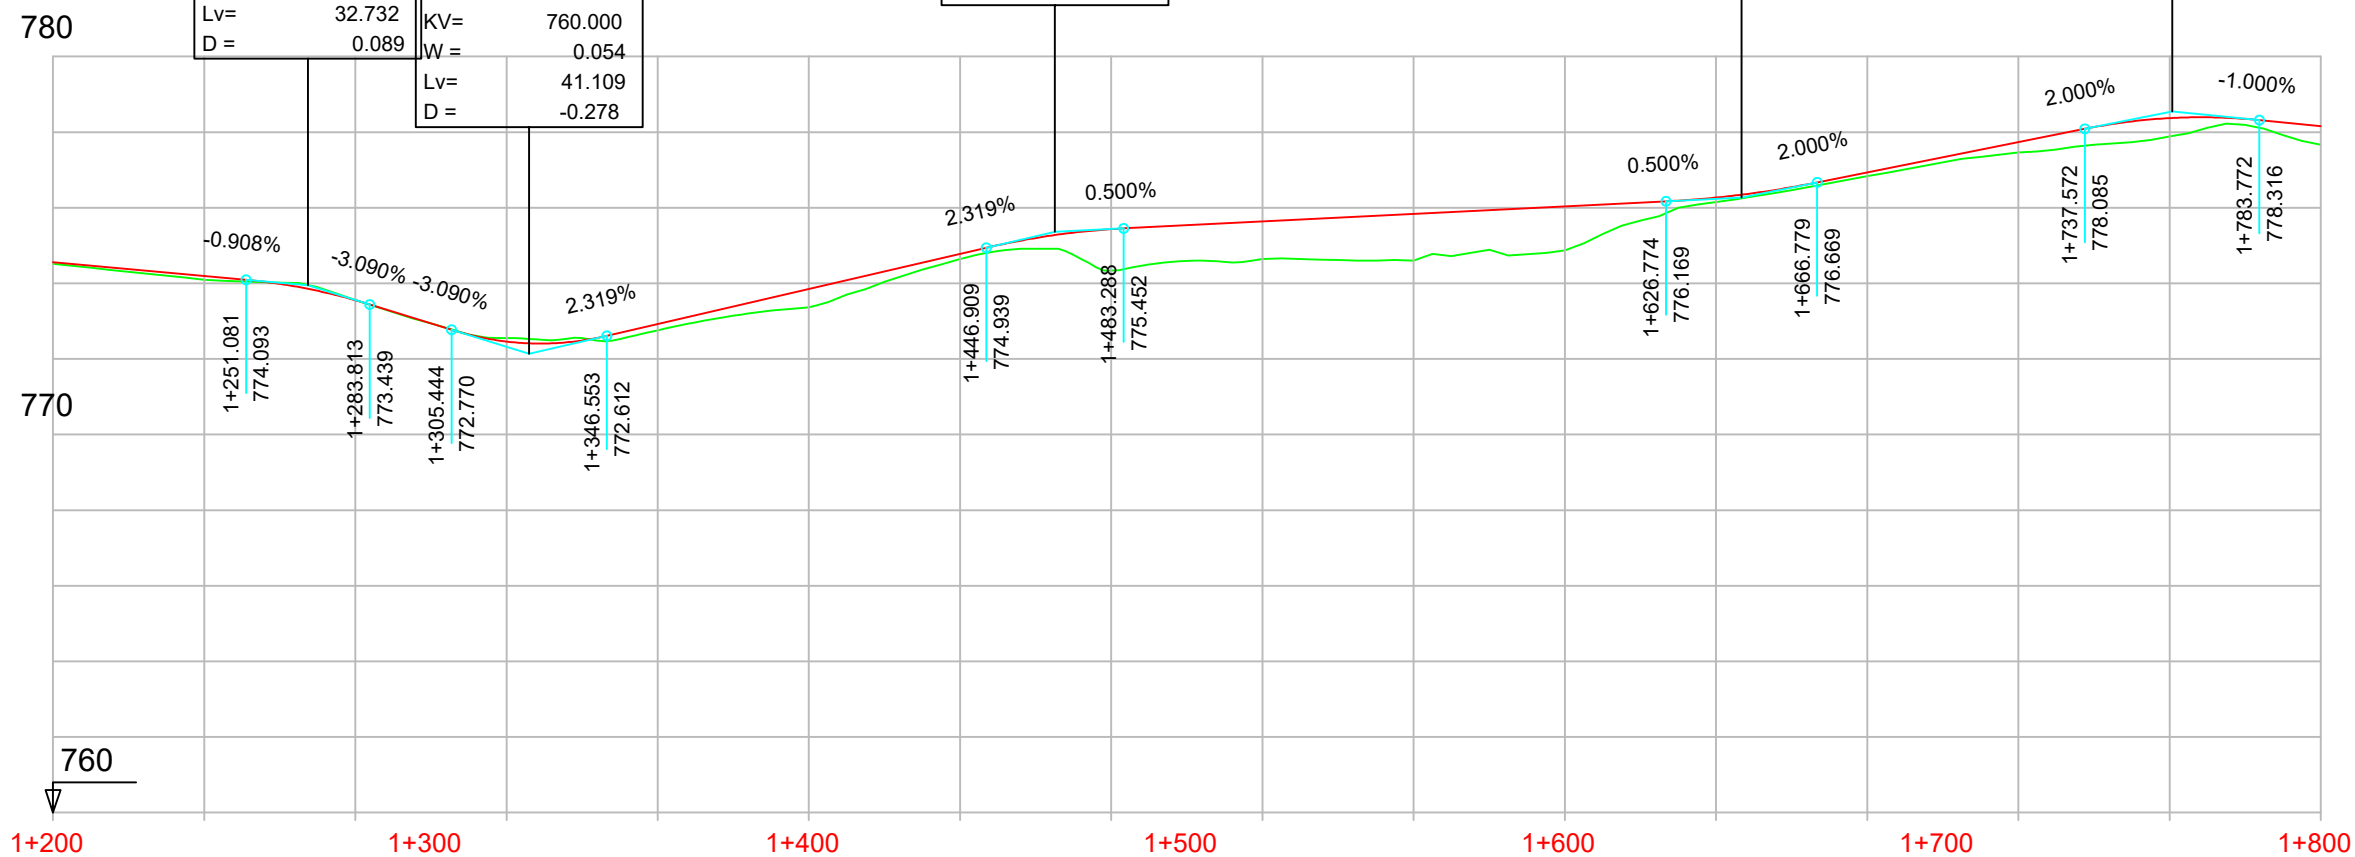

P.K.		
COTAS	RASANTE	TERRENO
1+200	774.557	774.52
1+251.081	774.194	774.09
1+283.813	773.552	773.56
1+305.444	772.460	772.55
1+346.553	772.924	772.76
1+404.185	773.851	773.36
1+446.909	774.779	774.64
1+483.288	775.433	774.34
1+514.958	775.635	774.64
1+571.000	775.835	774.60
1+608.571	776.035	774.88
1+646.776	776.268	776.15
1+684.291	776.934	776.83
1+721.816	777.734	777.46
1+760.672	778.370	777.88
1+800	778.154	777.67

DIAGRAMA DE CURVATURAS	
RECTA	RECTA
RECTA	RECTA
RECTA	RECTA
RECTA	RECTA

DIAGRAMA DE PERALTES	
BD:2.00%	BD:2.00%
BD:7.00%	BD:7.00%
BD:7.00%	BD:7.00%
BD:2.00%	BD:2.00%
BD:2.00%	BD:2.00%

